

The Heating, Refrigerating and Air Conditioning Institute of Canada (HRAI) is a not-for-profit national trade association serving the HVACR industry and the public interest. HRAI provides a wide range of informational and educational opportunities for building officials. Just as contractors, building owners, and building managers need to keep up to date in our ever-changing HVACR industry, building officials also need to know the "facts" and need to keep current. HRAI continues to work closely with OBOA and salutes the various municipalities across Canada who have joined the association as associate members. HRAI, through its national network of chapters, provides a means for building officials, contractors, wholesalers, manufacturers and consultants to work together.

For more information on materials and courses call HRAI at 905-602-4700 (fax 602-1197).

HRAI is pleased to provide the support for the timely and ongoing information in this column for OBOA members.

## Residential Ventilation Issues

by Dara Bowser & Bob Allison

### What Switches Go Where for Ventilation Systems

The Ontario Building Code Section 9.32 has several inter-related requirements for controls. These may be summarized as follows:

a) The *Principal Ventilation Fan* is required to be controlled by a centrally located on-off switch which is marked "Ventilation Fan". A dehumidistat or other automatic control may be used, but it must be in addition to the manual switch. [9.32.3.4.(2), (3),(4)] Because the *Principal Ventilation Fan* is interpreted to include the exhaust fan of an HRV, these control requirements also apply to HRV's unless the entire system is designed according to Part 6.

A simple dehumidistat is not acceptable, and must be accompanied by a manual control, or incorporate an "on-off" switch. Some HRVs

incorporate a "ventilate" and "re-circulate" position switch which can be taken to meet the requirement because effectively the ventilation system is "off" when the switch is in the "re-circulation" position.

b) When the *Principal Exhaust Fan* is more than 50% larger than the required capacity, then it must be able to be speed controlled to within 10% of the required capacity, and the speed control must be in the same location as the "Ventilation Fan" switch. [9.32.3.4.(6)] This requirement is designed to prevent the use of systems which would over-ventilate the home if they were left on continuously at their lowest speed. To meet this requirement, the centrally located control must be equipped with an on-off function as well as the speed control. In a simple form, this could be provided by a rotary-type variable speed control with an "off" position. For an HRV, this could be provided by a manual on-off switch and a high-speed override. The high-speed override could be provided by a dehumidistat.

c) *Supplemental exhaust fans* are required to be controlled in the same room as the exhaust air inlet. [9.32.3.5.(5)] This requirement is simply met when the Supplemental Exhaust fans are individual exhaust fans. For over-head fans an on/off wall switch (separate from the light switch) is used, and for a rangehood, the switch is usually located on the hood itself.

In the case where a *Principal Exhaust Fan* also provides the required exhaust from a kitchen, a water-closet or bathroom, the fan would be required to be controlled by a switch in the room(s) which it serves in addition to the centrally located "Ventilation Fan" switch. The OBC is not clear as to how the two switches are to work together, but the best arrangement is a parallel set-up where any switch may turn the fan on, and all switches are required to be off for the fan to be off.



VENTILATION FAN

CIRCULATION FAN



In the case of a two-speed exhaust fan or HRV, it would be appropriate to locate high-speed override switches (rather than on-off switches) in the rooms that the fan or HRV serves. Some HRV systems use one-shot internal timers that operate the system on high speed for a fixed period of time (15 to 30 minutes) after which the system returns to low speed or off, depending on the setting of the centrally located switch. A dehumidistat is not an appropriate control for use in these locations and sentence 9.32.3.5(6) asks for a manual control in addition to the dehumidistat.

d) In the case of any system which depends on a forced-warm air system to distribute ventilation air, a "Circulation Fan" switch is required to be located beside the "Ventilation Fan" switch. The "Circulation Fan" switch is required to control the furnace blower so that it will operate to circulate air around the house without operating the heating or cooling functions of the furnace. The location of these two switches beside each other is all that is required to satisfy the "Coupling" requirements of Sub-section 9.32.3.6.

Although the OBC does not require it, a furnace with a two-speed blower will give much better results than a system with a single speed blower. In some situations, the "Circulation Fan" switch can be incorporated into the base of the thermostat as the "Fan" switch. In this situation however, the markings on the thermostat do not correspond strictly with the requirements of sentence 9.32.3.6.(5).


Some HRVs are able to be equipped with circuits which interlock them to the furnace so that when the "Ventilation Fan" switch is operated, the furnace blower will automatically be turned on. If this control arrangement is installed, then there is no need for the "Circulation Fan" switch. It should be noted that anyone connecting controls to a furnace requires the appropriate knowledge and qualifications.

This and other topics are covered in detail in the 2-day OBOA workshop: "Residential Ventilation Systems for Building Officials".

*Dara Bowser is an HRAI Ventilation Instructor, an associate member of the CSA Technical Committee on Residential Mechanical Ventilation. Dara has been involved in residential ventilation as a consultant, manufacturer, and trainer for the past 12 years.*

*Bob Allison is the Deputy Chief Building Official of the Regional Municipality of Haldimand-Norfolk and has 20 years experience as a building official. Bob takes a keen interest in the development of the 2-day OBOA Ventilation Workshop for Building Officials.*

**BUILDING INSPECTION  
ONTARIO BUILDING CODE  
Part 9 - Housing Manual**

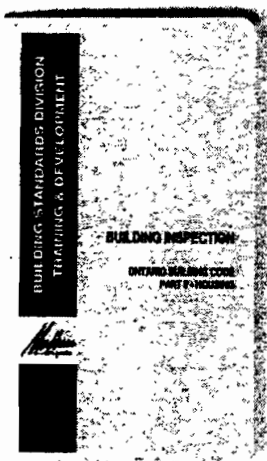

- a complete and current reference to conducting Ontario Building Code Inspections
- building & H.V.A/C
- purpose of inspection
- building code reference
- key points for inspection
- inspection techniques
- checklists
- inspector hints
- background information
- index
- pocket-size 4" x 6" x 3/4"
- 263 Pages

**Only \$20.00**

*including delivery and taxes*

**Call to Order Your Copy**

**(905) 477-7000 Ext. 285 & 743**

**TOWN OF MARKHAM**

**Administration & Customer Services - "Customer First Program"**

